


STA 31+80.56 6.72 LT  
 INSTALL:  
 1- 8" x 6" TEE (MJFLG)  
 1- 8" GV (MJ)  
 1- 6" GV (FLGMJ)  
 RECONNECT EXISTING 6" FIRE HYDRANT AFTER  
 CHLORINATION PER SCWD STD. S-9 & S-10.  
 (PROVIDE BAG OVER HYDRANT WHEN OUT OF SERVICE)

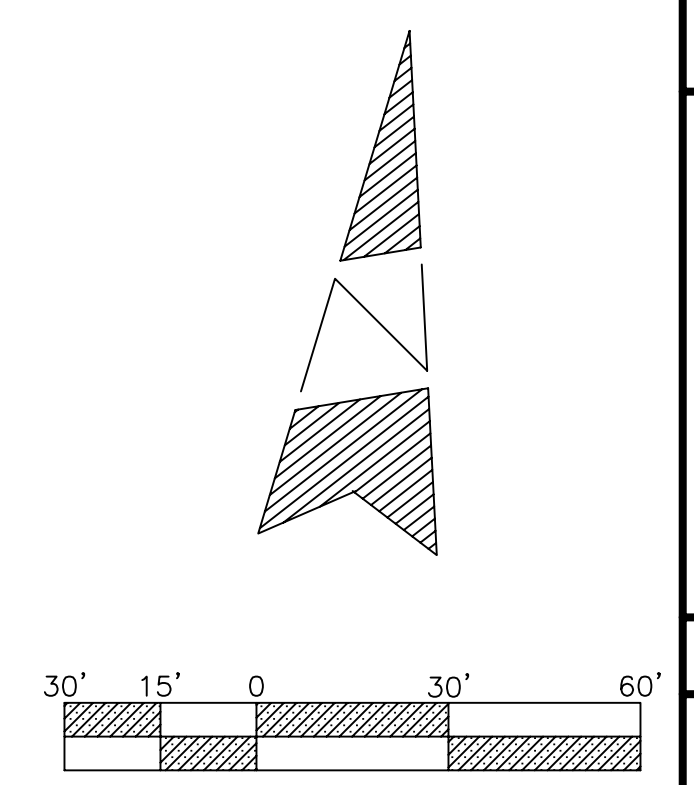

SERVICES:  
 REPLACE 7 WITH 1" PE TUBING AND B-9 METER BOX  
 RECONNECT 5 TO NEW MAIN (9701, 9728, 9725, 9755 MONROE, 271 JAUNELL)  
 RAISE METER AND BOX AT 9701 MONROE TO GRADE

INSTALL 1 - 8" 22.5° EL (MJ) AT EACH LOCATION:

A	STA 29+44.75 2.16 RT	F	STA 34+99.58 6.44 LT
B	STA 30+93.35 6.74 LT	G	STA 35+71.46 2.28 RT
C	STA 31+74.07 7.77 LT	H	STA 36+05.81 2.57 LT
D	STA 33+52.96 5.46 LT	I	STA 36+59.52 7.37 LT
E	STA 34+31.46 0.76 LT	J	STA 38+00.73 8.99 RT

Date	02/17/04
Revision/Issue	ISSUED FOR APPROVAL
No.	0
	ISSUED FOR CONSTRUCTION

**MONROE AVENUE MAIN REPLACEMENT**

APTOS, SANTA CRUZ COUNTY, CALIFORNIA  
 APN: N/A  
 G:\01\_Proj\_Current\03-120\Draw\Rev\_0\D-4.dwg 2-24-04 09:02:47 AM tojd

**SOQUEL CREEK WATER DISTRICT**  
 PO Box 158 Soquel, California 95073  
 Phone Number: (831) 475-8500  
 Fax Number: (831) 475-4291

CWO. NO. 03-120  
 DATE: 10/30/02  
 SCALE: 1" = 30'  
 DESIGN BY: TAD  
 DWC. NO. D-03-2113-F

Certification:  
  
 Jeffery N. Gailey  
 Chief Engineer  
 Engineering Manager

SHEET:  
**D-4**