



INSTALL:
 450 SQ. FT. X 6" THK CONCRETE TANK
 FOUNDATION AND FILL APRON.
 (APPROX. 10.5 YDS OF 3KSI CONC.)
 (APPROX. 10 YDS OF CLASS II BASEROCK)

70 L.F. X 36" WIDE X 8" HIGH AC BERM

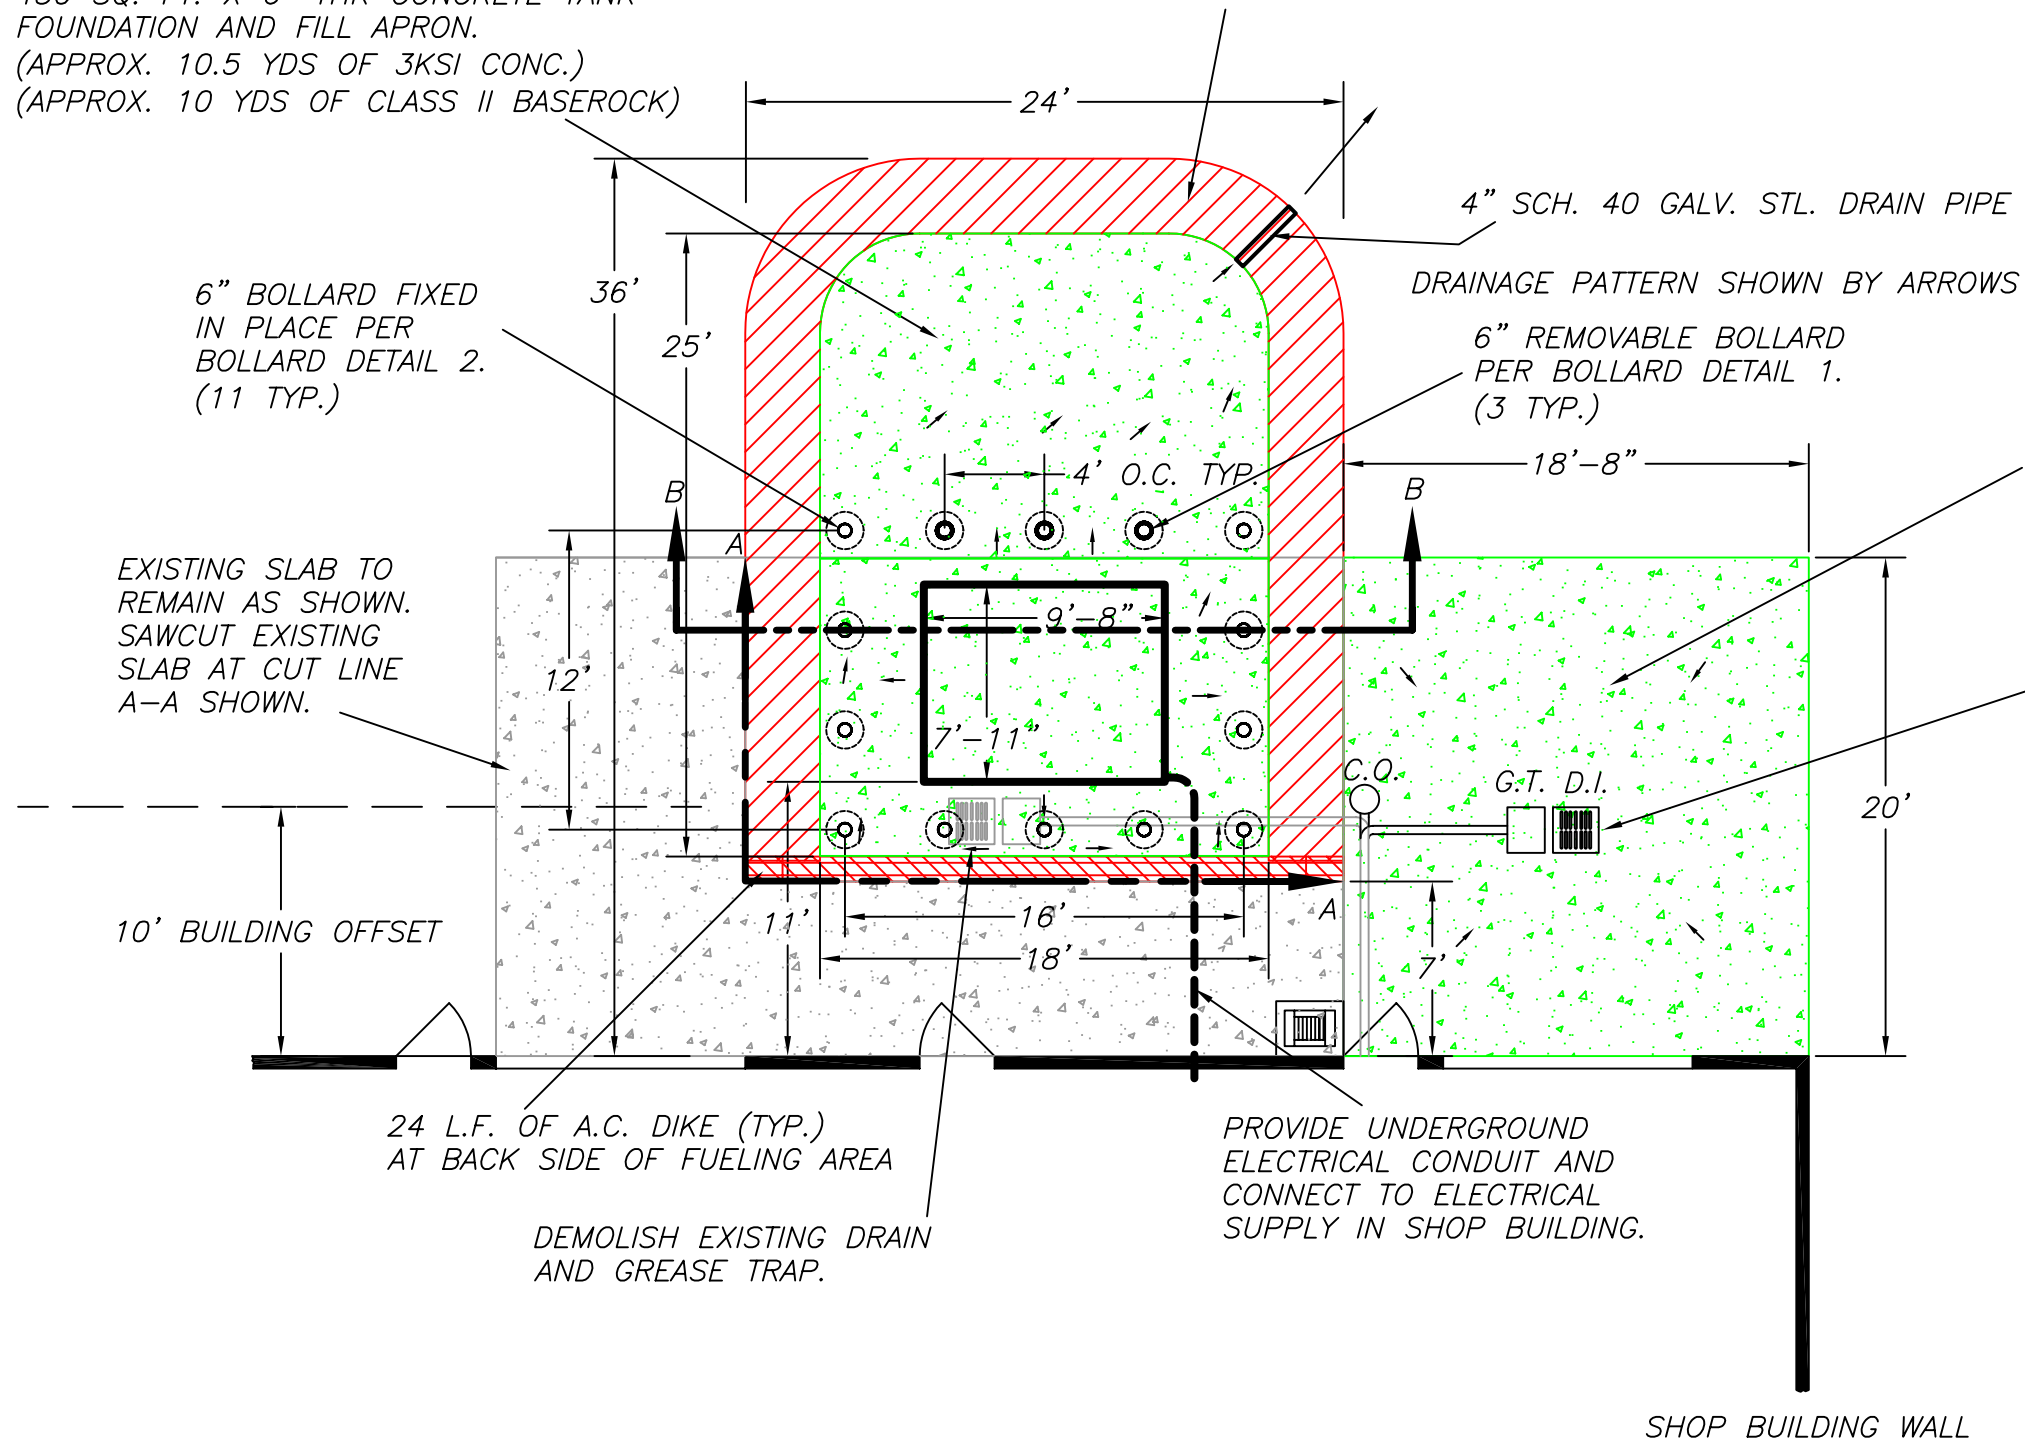

CONSTRUCT NEW CONCRETE WASH AREA
 (18'-8" X 20' X 6" THICK) SLAB WITH #4
 REBAR @ 12" O.C. EACH WAY CENTERED IN
 SLAB THICKNESS.
 375 SQ. FT. X 6" THK. CONCRETE
 375 SQ. FT. X 6" CL. II BASEROCK
 (APPROX. 7 YDS. OF 3KSI CONC.)
 (APPROX. 7 YDS. OF CL. II BASEROCK)

INSTALL U23 CATCH BASIN AND GREASE TRAP
 W/ GRATING TO SUPPORT AASHTO H-20
 TRAFFIC LOAD. TIE INTO EXISTING SEWER LINE
 AND INSTALL NEW CLEAN-OUT BOX AS
 SHOWN.

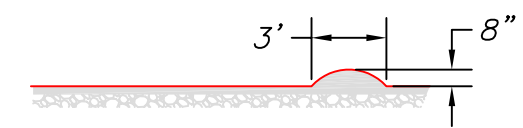

BERM DETAIL

HEADQUARTERS ABOVE GROUND
 FUEL TANK INSTALLATION

No.	Revision/Issue	Date
A	ISSUED FOR APPROVAL	11/18/03
0	ISSUED FOR CONSTRUCTION	11/18/03

SOQUEL, SANTA CRUZ COUNTY, CALIFORNIA
 APN: 030-242-43

G:\01_Proj_Current\03-144\3rd_time_out_to_bid\Rev_04B-2.dwg 11-18-03 01:19:43 PM tjd

SOQUEL CREEK
 WATER DISTRICT
 PO Box 158 Soquel, California 95073
 Phone Number: (831) 475-8500
 Fax Number: (831) 475-4291

CWO. NO. 03-144
 DATE: 03/20/03
 SCALE: 1/8" = 1'
 DESIGN BY: TAD
 SHEET
B-2
 DWG. NO. B-03-2121-H

Certification:

 REGISTERED PROFESSIONAL ENGINEER
 JEFFERY N. GAILEY
 No. 47298
 Exp. 12/31/03
 CIVIL
 STATE OF CALIFORNIA

Jeffery N. Gailey
 Chief Engineer
 Engineering Manager