

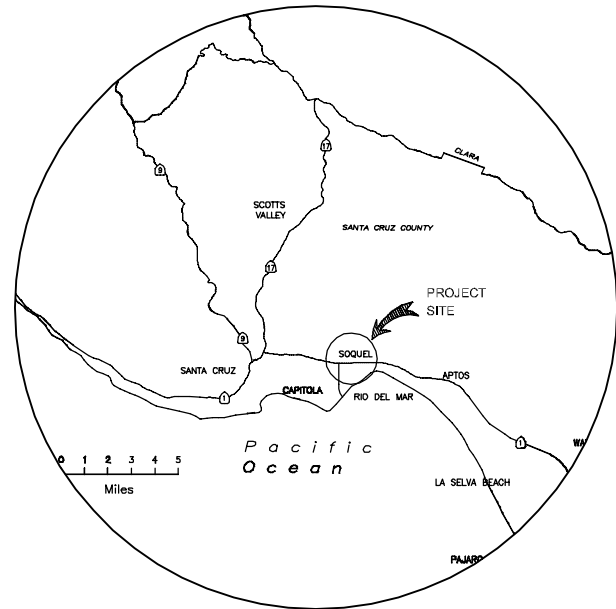


**CENTER STREET**  
 350± L.F. 6" C900 CLASS 200 PVC WATER MAIN  
 1 CHLORINATION TAP  
 1 2" TEMPORARY BLOW-OFF ASSEMBLY  
 7 STANDARD DOMESTIC SERVICE REPLACEMENTS  
 1 HOT TAP TO EXISTING 6" AC WATER MAIN  
 1 TIE-IN TO EXISTING 6" AC WATER MAIN  
 6,500± S.F. TYPE II SLURRY SEAL

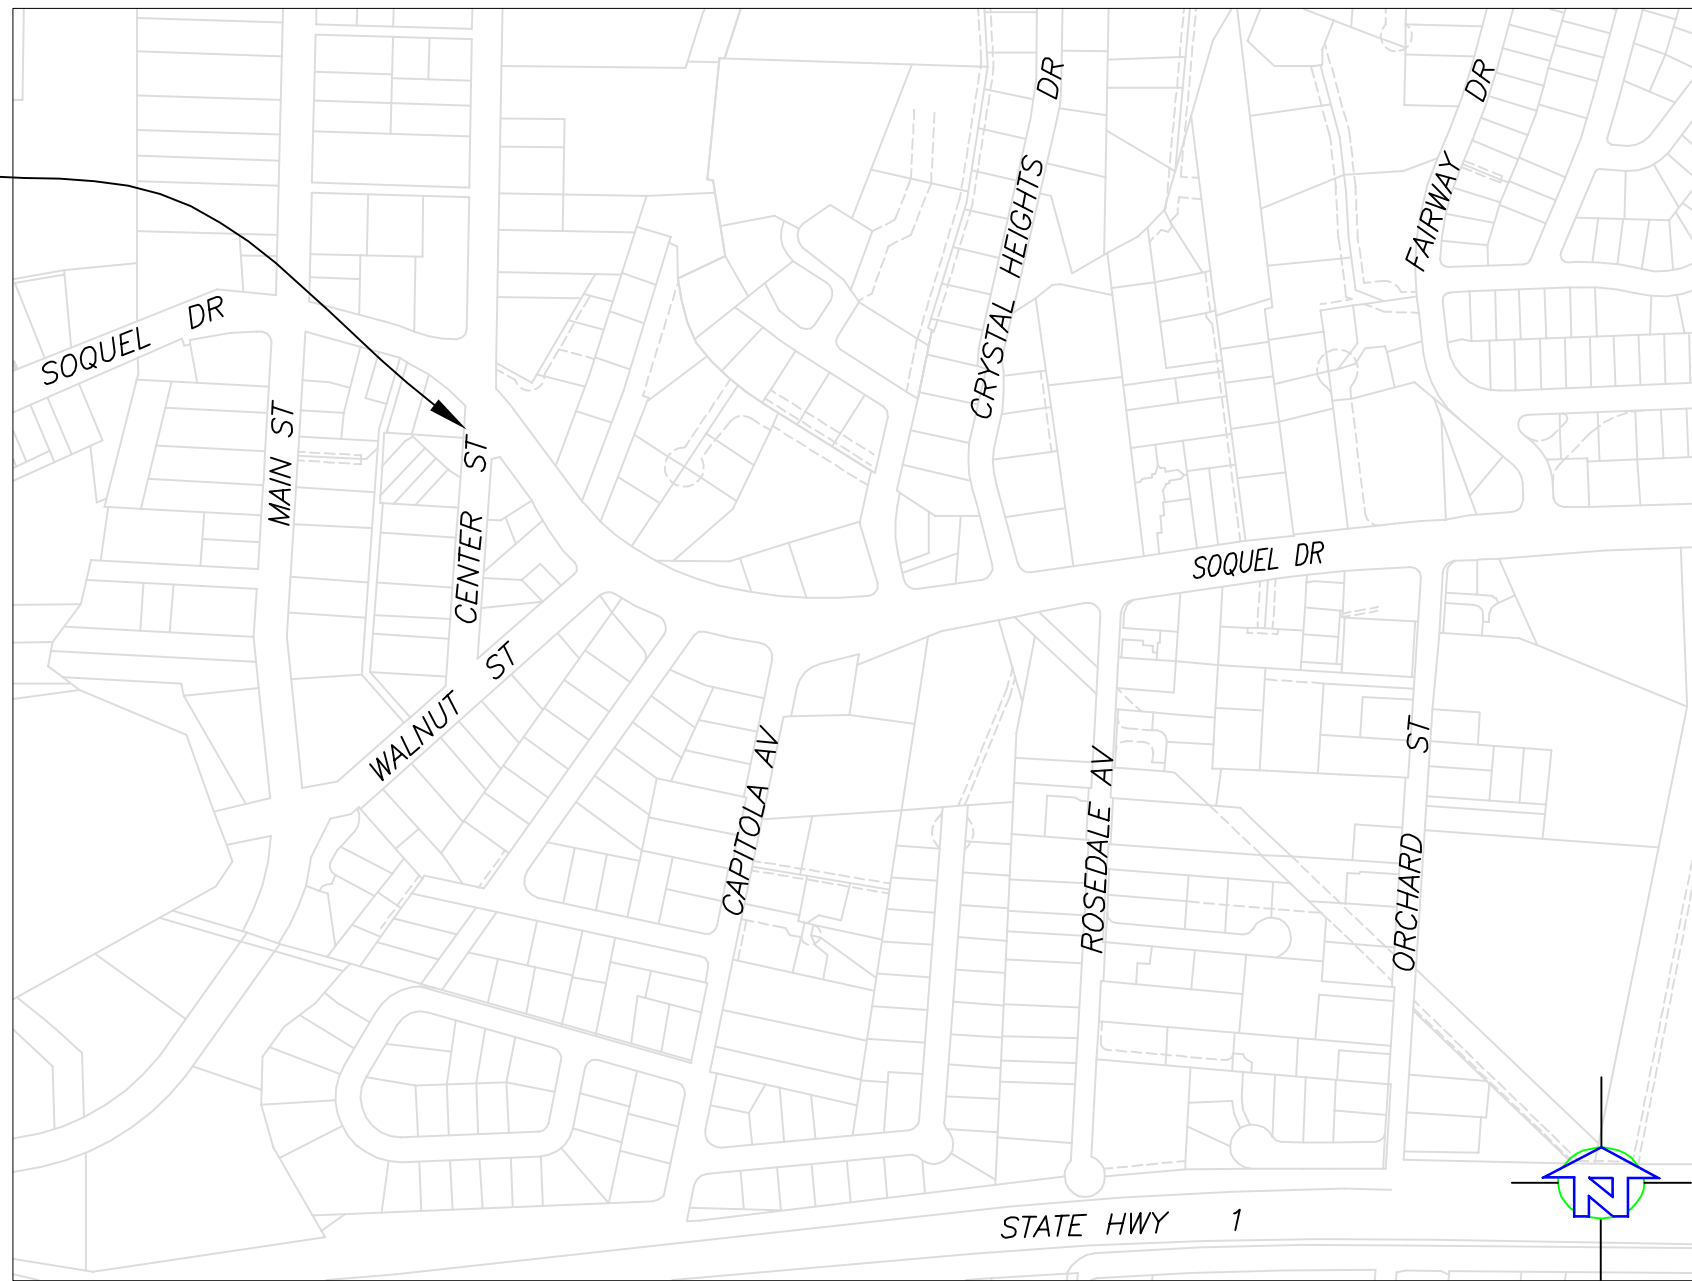

### Vicinity Map

Not to Scale

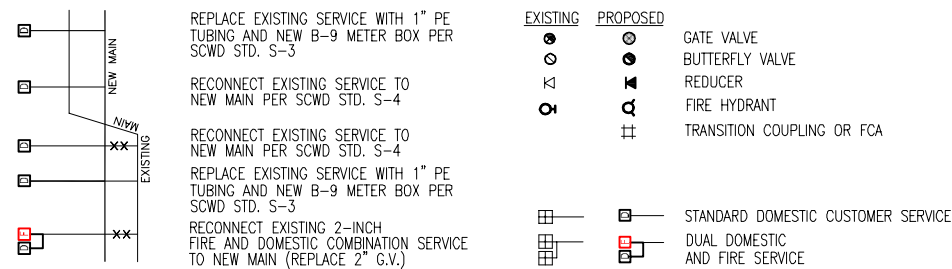

### Key Map

Scale 1" = 400'

### Water Works Notes:

- ALL WATERWORKS RELATED CONSTRUCTION SHALL BE PERFORMED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS AND STANDARD PLANS, AND THE DIRECTIONS OF THE CHIEF ENGINEER OF THE SOQUEL CREEK WATER DISTRICT. A COPY OF THE SOQUEL CREEK WATER DISTRICT STANDARD SPECIFICATIONS AND STANDARD PLANS SHALL BE AVAILABLE ON THE JOB SITE AT ALL TIMES. COPIES MAY BE OBTAINED AT THE OFFICES OF THE SOQUEL CREEK WATER DISTRICT, 5180 SOQUEL DRIVE, SOQUEL, CA 95073.
- THE CONTRACTOR SHALL NOTIFY THE CHIEF ENGINEER OF THE SOQUEL CREEK WATER DISTRICT A MINIMUM OF 2 WORKING DAYS PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL SCHEDULE ALL INSPECTIONS WITH THE SOQUEL CREEK WATER DISTRICT A MINIMUM OF 24 HOURS IN ADVANCE OF NEEDING SUCH INSPECTION. ALL VALVES SHALL ONLY BE OPERATED BY THE PERSONNEL OF THE SOQUEL CREEK WATER DISTRICT. SYSTEM SHUTDOWNS FOR THE INTERCONNECTION OF NEW IMPROVEMENTS TO THE EXISTING SYSTEM SHALL BE SCHEDULED WITH THE SOQUEL CREEK WATER DISTRICT A MINIMUM OF 3 WORKING DAYS IN ADVANCE FOR RESIDENTIAL AREAS AND 5 WORKING DAYS IN ADVANCE FOR COMMERCIAL AND INDUSTRIAL AREAS.

### Notes:

- THIS IS NOT A BOUNDARY OR TOPOGRAPHIC SURVEY. RIGHT OF WAY AS SHOWN IS COMPILED FROM RECORD DATA AND RECONCILED TO BEST FIT RANDOM FOUND MONUMENTS. LOT LINES ARE GENERATED FROM ASSESSOR'S MAPS.
- UTILITIES SHOWN ARE BASED ON SURFACE EVIDENCE, USA MARKED LOCATIONS AND/OR RECORD DRAWING LOCATIONS AS PROVIDED BY AGENCIES. NO POT-HOLING OR VERIFICATION OF UNDERGROUND LOCATIONS HAS BEEN PERFORMED. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION PRIOR TO CONSTRUCTION.

### Sheet Index

Key Map  
 Center Street Main Replacement

Sheet 1  
 Sheet 2

## CENTER STREET MAIN REPLACEMENT COVER SHEET

No.	Revision/Issue	Date
A	ISSUED FOR REVIEW	10/27/04

SOQUEL, SANTA CRUZ COUNTY, CALIFORNIA  
 APN: N/A  
 G:\01\_Proj\_Current\04-40\Draw\Rev\_A\B-1.dwg 12-10-04 11:07:33 AM tofp

**SOQUEL CREEK WATER DISTRICT**  
 PO Box 158 Soquel, California 95073  
 Phone Number: (831) 475-8500  
 Fax Number: (831) 475-4291

CWO. NO. 04-40  
 DATE: 10/27/04  
 SCALE: AS NOTED  
 DESIGN BY: AVW

SHEET  
**B-1**

Certification:  
  
 No. 47298  
 Exp. 12/31/05  
 CIVIL  
 STATE OF CALIFORNIA

Jeffery N. Gailey  
 Chief Engineer  
 Engineering Manager