


SOQUEL DR

WALNUT ST

APPLY:
6,500± S.F. TYPE II SLURRY SEAL

INSTALL:
350 L.F. ± OF 6" C900 CLASS
200 PIPE

INSTALL:
1 - 6" TAPPING SLEEVE
1 - 6" GATE VALVE (FLG X MJ)
1 - CHLORINATION TAP

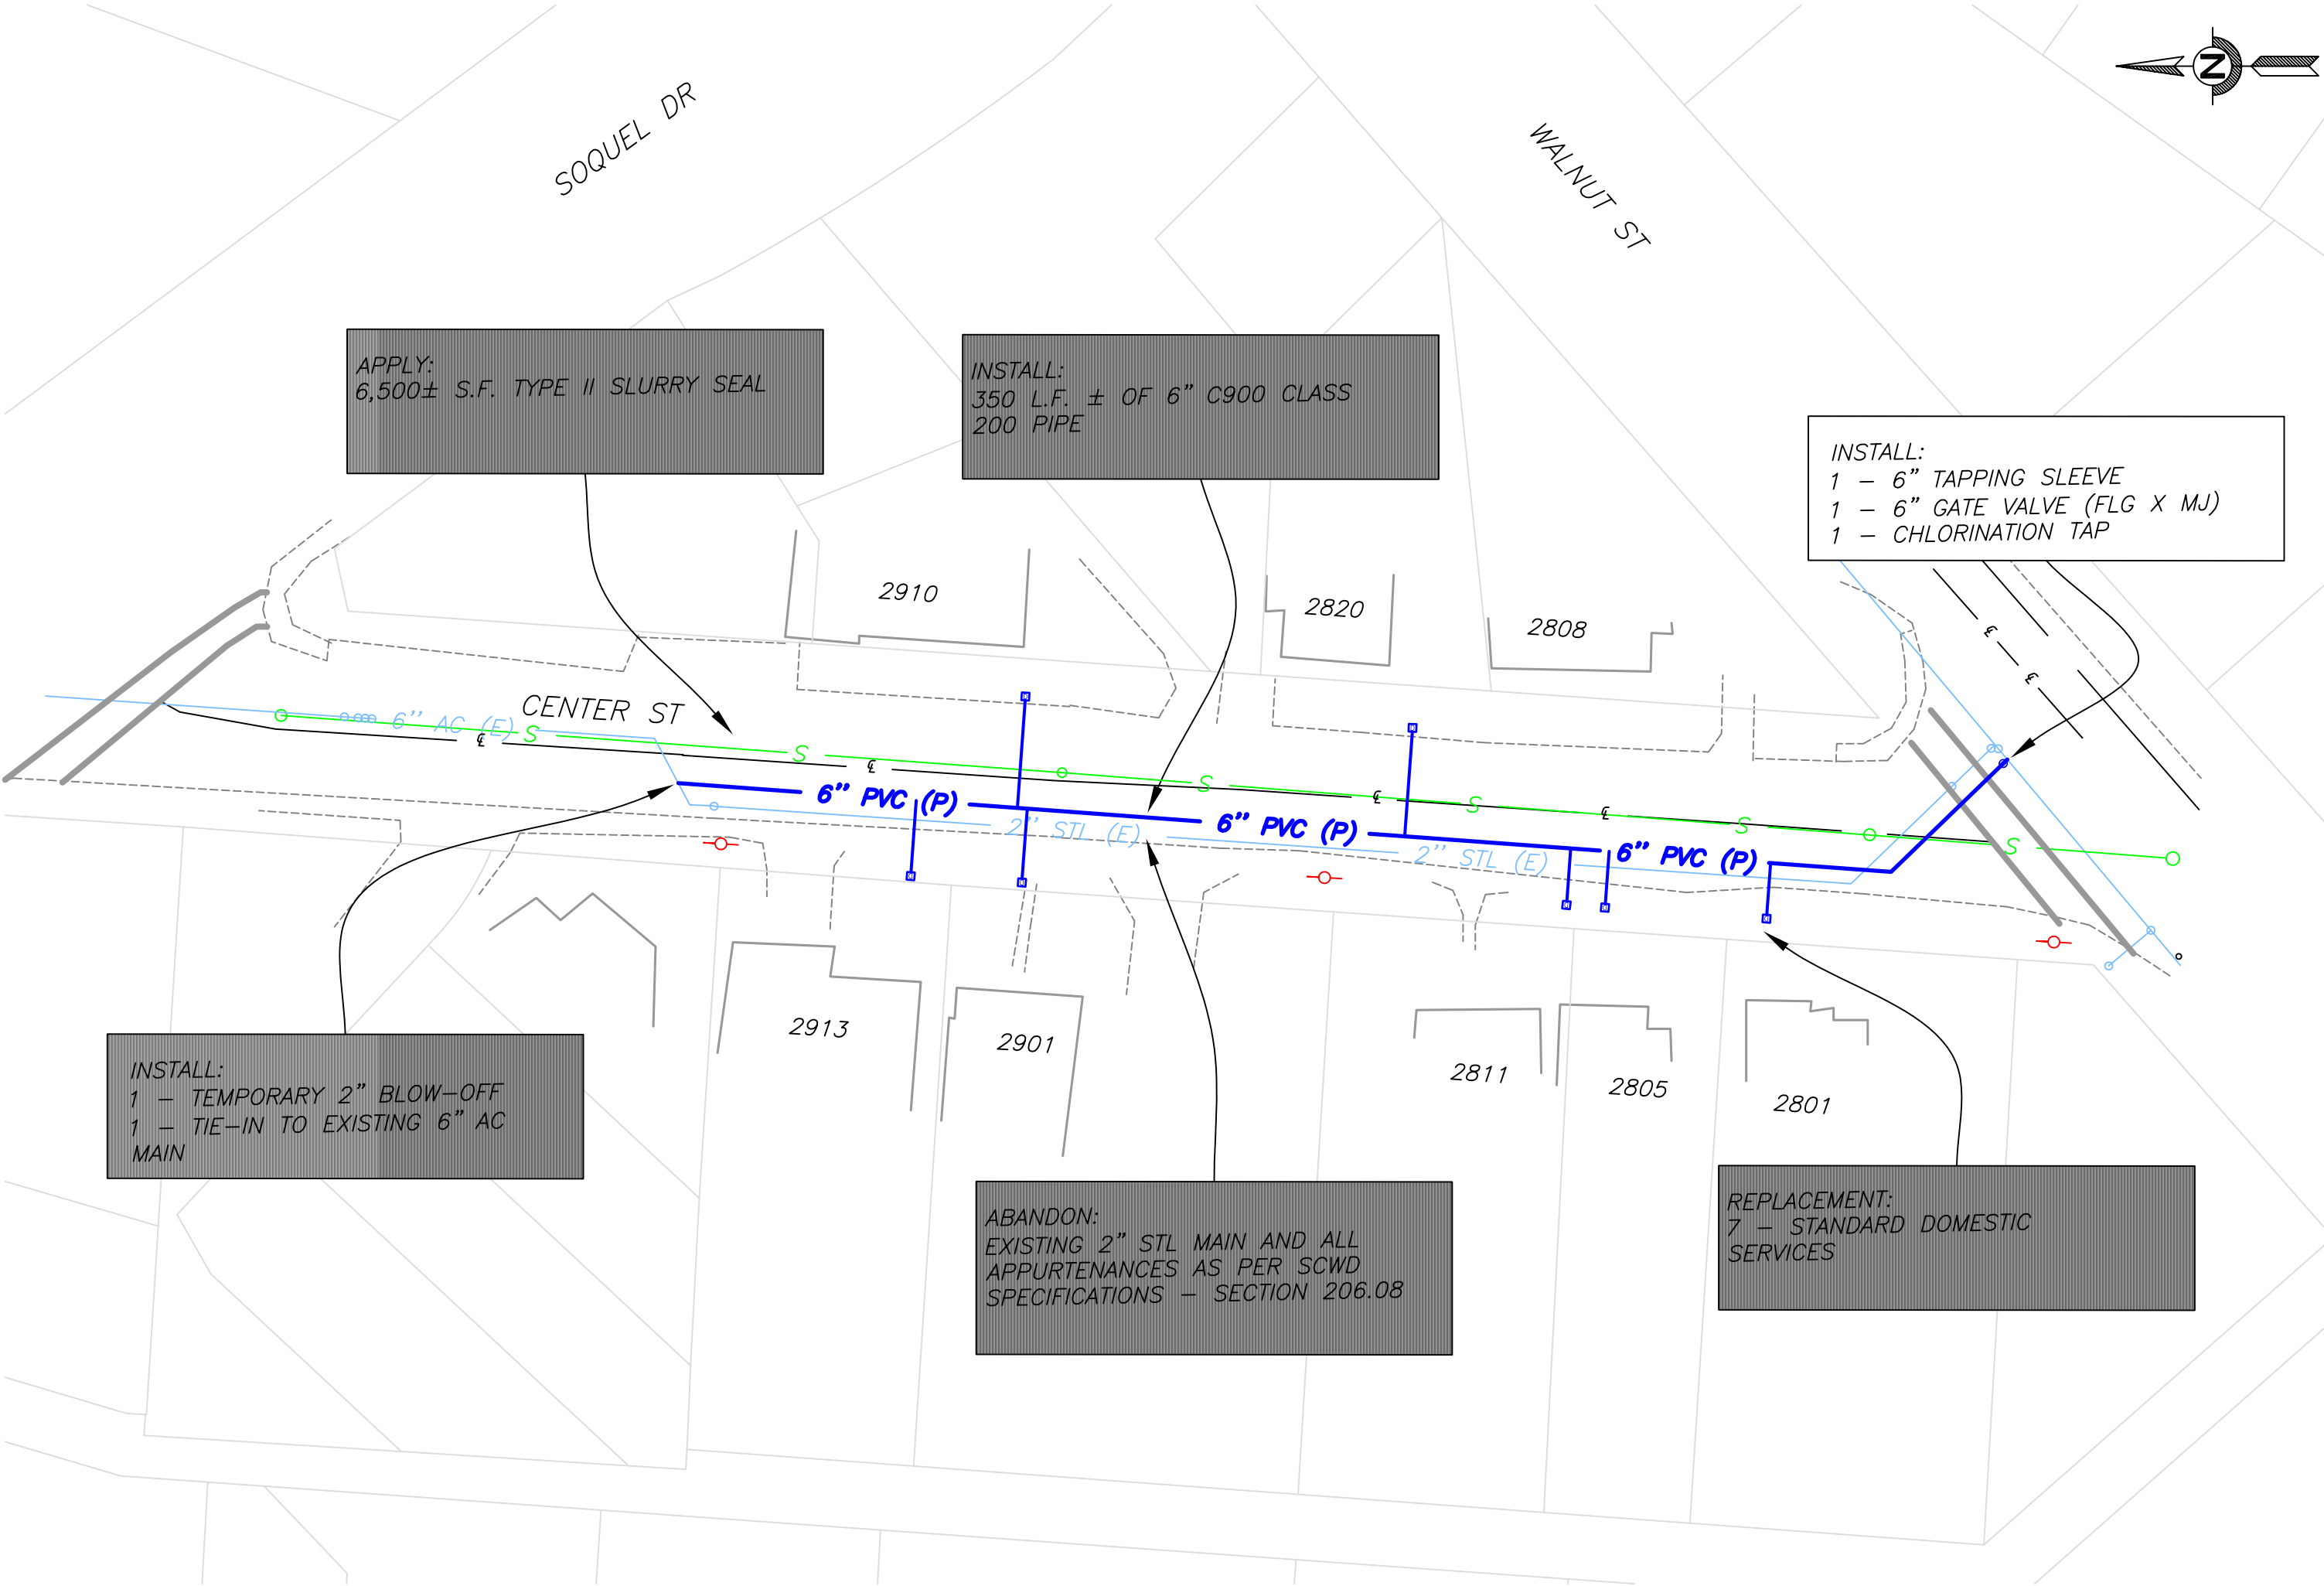

INSTALL:
1 - TEMPORARY 2" BLOW-OFF
1 - TIE-IN TO EXISTING 6" AC
MAIN

ABANDON:
EXISTING 2" STL MAIN AND ALL
APPURTENANCES AS PER SCWD
SPECIFICATIONS - SECTION 206.08

REPLACEMENT:
7 - STANDARD DOMESTIC
SERVICES

No.	Revision/Issue	Date
A	ISSUED FOR REVIEW	10/27/04

CENTER STREET MAIN REPLACEMENT

CWO. NO. 04-40
DATE: 10/27/04
SCALE: 1"=40'
DESIGN BY: AVW

DWG. NO.
B-05-2141-H

SOQUEL CREEK
WATER DISTRICT
PO Box 158 Soquel, California 95073
Phone Number: (831) 475-8500
Fax Number: (831) 475-4291

SOQUEL, SANTA CRUZ COUNTY, CALIFORNIA
APN: N/A
c:\01_Proj_Current\04-40\Draw\Rev_A\B-2.dwg 12-10-04 11:11:07 AM tajd