



CAPITOLA DEL MAR  
 INVENSYS 3" SRH COMPOUND METER & STRAINER W/ BYPASS  
 B48M2 CHRISTY BOX AND LID  
 1 3" OR 2" PARALLEL INSTALLATION BACK FLOW ASSEMBLIES  
 SERVICE RECONNECTION  
 1 TAP TO EXISTING 8" AC WATER MAIN

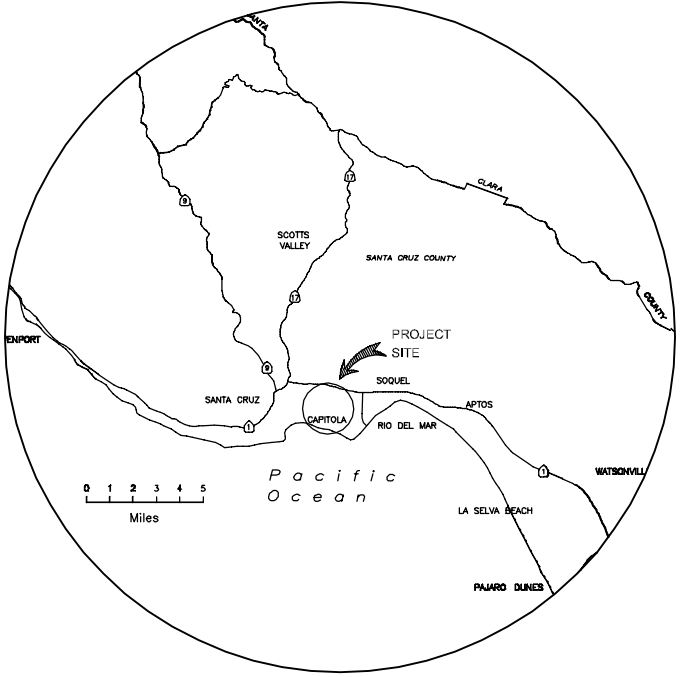

# Vicinity Map

Not to Scale

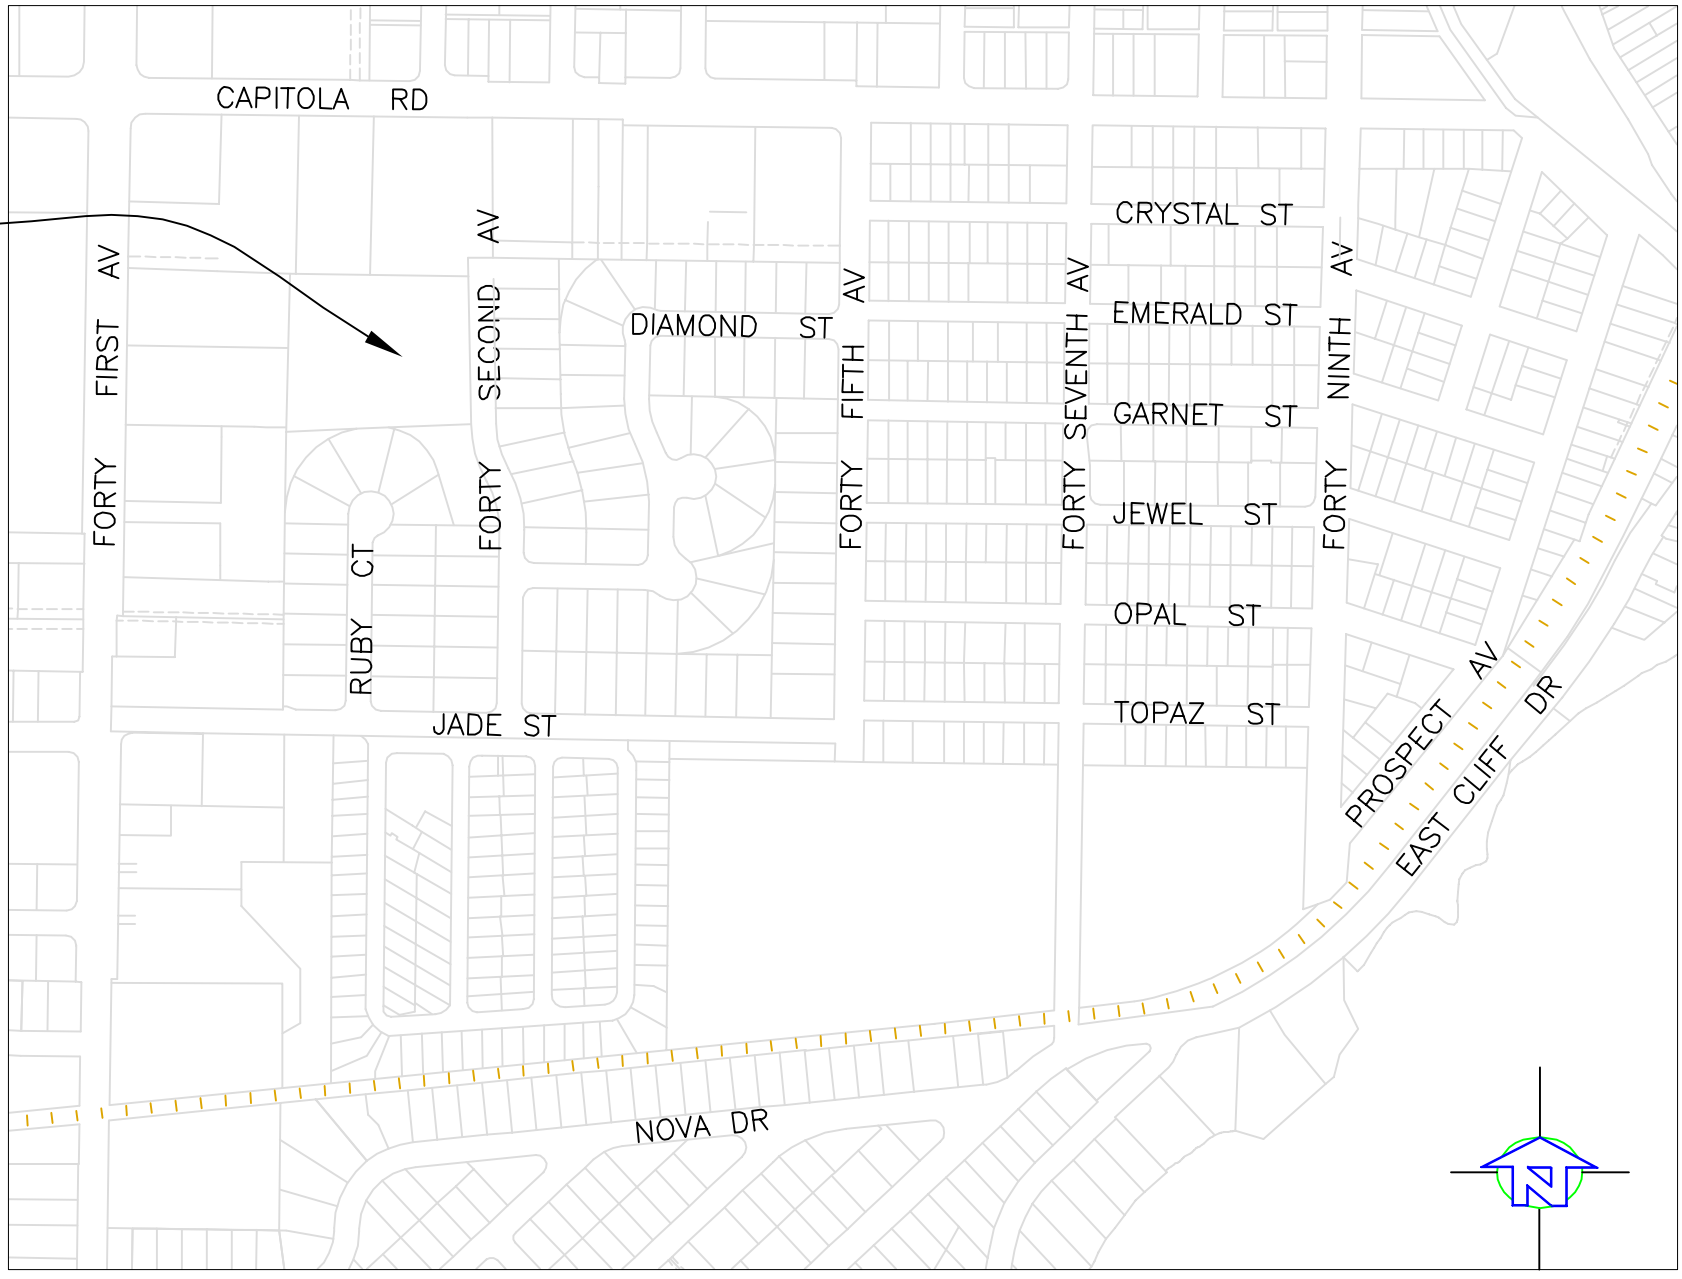

# Key Map

Scale 1" = 400'

Legend		
	REPLACE EXISTING SERVICE WITH 3" PVC PIPING AND NEW B48M2 METER BOX PER SCWD STD. S-18	
	(E) WATER MAIN	
	GAS SERVICE PIPE	
	UNDERGROUND ELECTRICAL	
	PROPERTY LINE	
<b>EXISTING</b>	<b>PROPOSED</b>	
		REDUCER
		TAP
		FIRE HYDRANT
		GATE VALVE
		CUSTOMER SERVICE

## Water Works Notes:

- ALL WATERWORKS RELATED CONSTRUCTION SHALL BE PERFORMED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS AND STANDARD PLANS, AND THE DIRECTIONS OF THE CHIEF ENGINEER OF THE SOQUEL CREEK WATER DISTRICT. A COPY OF THE SOQUEL CREEK WATER DISTRICT STANDARD SPECIFICATIONS AND STANDARD PLANS SHALL BE AVAILABLE ON THE JOB SITE AT ALL TIMES. COPIES MAY BE OBTAINED AT THE OFFICES OF THE SOQUEL CREEK WATER DISTRICT, 5180 SOQUEL DRIVE, SOQUEL, CA 95073.
- THE CONTRACTOR SHALL NOTIFY THE CHIEF ENGINEER OF THE SOQUEL CREEK WATER DISTRICT A MINIMUM OF 2 WORKING DAYS PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL SCHEDULE ALL INSPECTIONS WITH THE SOQUEL CREEK WATER DISTRICT A MINIMUM OF 24 HOURS IN ADVANCE OF NEEDING SUCH INSPECTION. ALL VALVES SHALL ONLY BE OPERATED BY THE PERSONNEL OF THE SOQUEL CREEK WATER DISTRICT. SYSTEM SHUTDOWNS FOR THE INTERCONNECTION OF NEW IMPROVEMENTS TO THE EXISTING SYSTEM SHALL BE SCHEDULED WITH THE SOQUEL CREEK WATER DISTRICT A MINIMUM OF 3 WORKING DAYS IN ADVANCE FOR RESIDENTIAL AREAS AND 5 WORKING DAYS IN ADVANCE FOR COMMERCIAL AND INDUSTRIAL AREAS.

## Notes:

- THIS IS NOT A BOUNDARY OR TOPOGRAPHIC SURVEY. RIGHT OF WAY AS SHOWN IS COMPILED FROM RECORD DATA AND RECONCILED TO BEST FIT RANDOM FOUND MONUMENTS. LOT LINES ARE GENERATED FROM ASSESSOR'S MAPS.
- UTILITIES SHOWN ARE BASED ON SURFACE EVIDENCE, USA MARKED LOCATIONS AND/OR RECORD DRAWING LOCATIONS AS PROVIDED BY AGENCIES. NO POTHOLING OR VERIFICATION OF UNDERGROUND LOCATIONS HAS BEEN PERFORMED. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION PRIOR TO CONSTRUCTION.

# Sheet Index

Key Map Sheet 1  
 Meter Relocation @ Capitola Sheet 2  
 Del Mar (1505 42nd Ave.)

# METER RELOCATION @ CAPITOLA DEL MAR (1505 42ND AVE.) COVER SHEET

**SOQUEL CREEK WATER DISTRICT**  
 PO Box 158 Soquel, California 95073  
 Phone Number: (831) 475-8500  
 Fax Number: (831) 475-4291

CWO. NO. 05-116 SHEET  
 DATE: 10/08/04  
 SCALE: AS NOTED  
 DESIGN BY: CCC  
 DWG. NO. B-05-2140-H  
 B-1



Jeffery N. Gailey  
 Chief Engineer  
 Engineering Manager

No.	Revision/Issue	Date
A	ISSUED FOR REVIEW	10/26/04
0	ISSUED FOR CONSTRUCTION	XX/XX/XX