



1" WATTS BALL
VALVE, MODEL B-6000
(DISTRICT SUPPLIED AND INSTALLED)

1" A36 STEEL PIPE
(DISTRICT SUPPLIED AND INSTALLED)

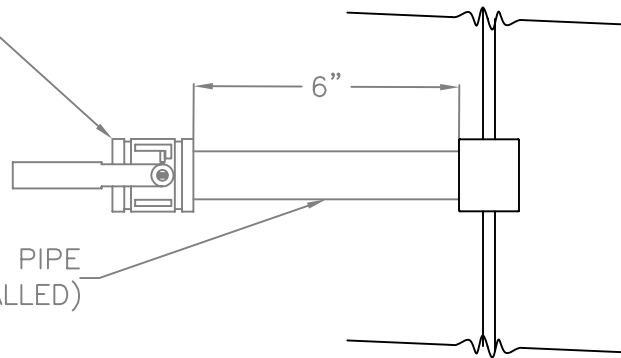

1/4" THK TANK WALL STL (E)

INSTALL 1" DIA. FIPT COUPLING

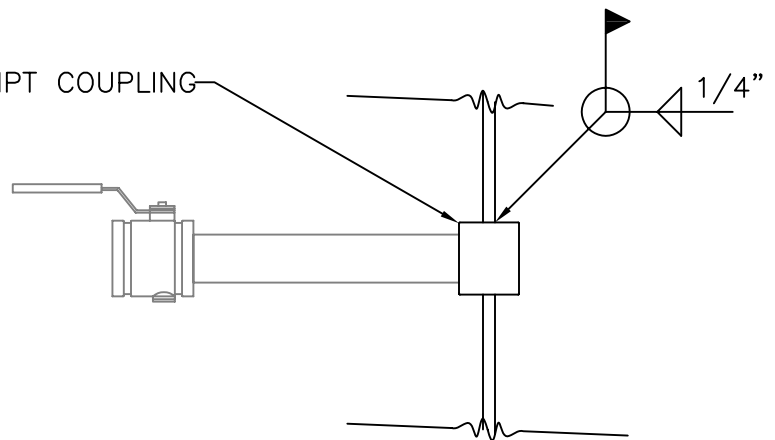

1/4" THK TANK WALL (E)

SCOPE OF WORK:

FIELD DRILL AND FIELD WELD THREE SAMPLE TAP COUPLINGS
TO EXISTING TANK WALL.

I:\01_Proj_Current\05-128\Draw\Rev_A\tap1.dwg 6-30-05 02:00:54 PM adamw

SAMPLE TAP DETAIL



**SOQUEL CREEK
WATER DISTRICT**

P.O. Box 158 Soquel, California 95073
Phone Number: (831) 475-8500
Fax Number: (831) 475-4291

CWO NO.
05-128

PJT. NAME: PARK WILSHIRE TANK
RECOAT PROJECT

REV
A

SCALE: NONE

DWN BY: TAD

SHEET: 1 OF 1