



5180 SOQUEL DR.
PO BOX 158
SOQUEL, CA 95073
TEL 831-475-8500
FAX 831-475-4291

BOARD OF
DIRECTORS

BRUCE DANIELS
President
Dr. THOMAS LAHUE
Vice President

DANIEL F. KRIEGE
JOHN W. BEEBE
Dr. BRUCE JAFFE

To: **Plan Holder**

Attn.: **Bidder**

Date: **March 9, 2007**

Project: **La Selva Beach Main
Replacements, Phase III**

CWO No.: **07-126**

Addendum No. 1

The contract documents for the **La Selva Beach Main Replacements Project, Phase III** project have been changed as follows:

- Tie-in detail at Altivo Ave. and Loma Ave. has changed. Attached drawing shall replace tie-in detail on 24 x 36 plans.

-

BID DATE REMAINS: Wednesday, April 11, 2007 AT 2:00 PM

Please adjust bids accordingly. If you would like a hard copy of this addendum, you may pick one up at the District Office, 5180 Soquel Drive, Soquel, CA 95073.

Bidder acknowledges receipt of this addendum, which shall be attached to and made a part of the proposal.

Contractor Representative

Date

Soquel Creek Water District
Jeffery N. Gailey, PE
Engineering Manager/ Chief Engineer

LOCATION OF GAS LATERAL UNKNOWN. CONTRACTOR SHALL DETERMINE LOCATION BEFORE EXCAVATION.

ADDENDUM 1. TIE IN REVISION AT ALTIVO AVE. AND LOMA AVE.


3/9/07

TIE-IN AT ALTIVO AVE. AND LOMA AVE. INSTALL:


- (1) 8" TRANSITION COUPLING ON EXISTING AC STUB OUT
- (1) 8"X 6" FLG. TEE.
- (2) 8" FLG. X M.J. G.V.
- (1) 6" FLG. X M.J. G.V.
- (1) 6" X 4" M.J. REDUCER
- (2) 4" 45° ELBOW, M.J.
- (1) 4" TRANSITION COUPLING TO TIE INTO EXISTING 4" O.D. STEEL MAIN ON LOMA AVE.
- THRUST BLOCKS AS NECESSARY
- (40) L.F. 8" PVC MAIN LINE FOR THRUST RESTRAINT ALONG ALTIVO AVE.
- (1) CHLORINATION TAP PER S-23.

AFTER NEW MAIN IS IN SERVICE, ABANDON EXISTING VALVES FEEDING 2½" & 4" O.D. STEEL MAINS.

AFTER NEW MAINS ON ALTIVO AND ELENA ARE IN SERVICE, REMOVE EXISTING 4" G.V. AND INSTALL EITHER 4" BLIND FLANGE OR 4" PLUG ON EXISTING 8"X4" R.T. X TAPPED TEE.



1 inch = 20 ft.

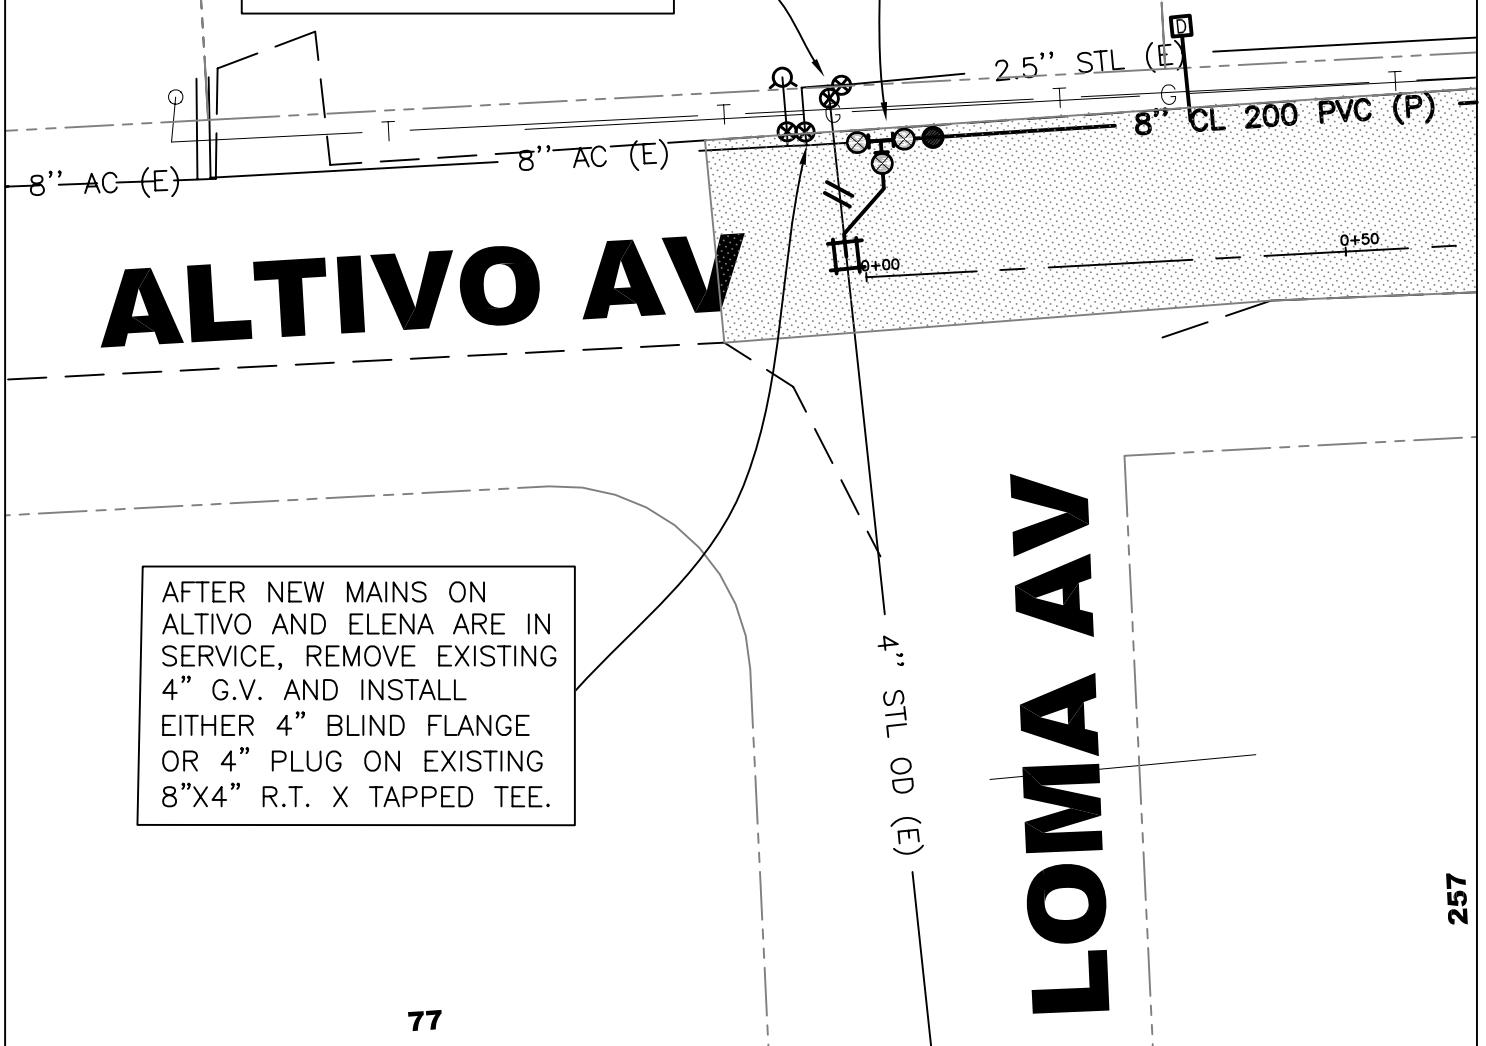

ALTIVO AV

LOMA AV