



1" WATTS BALL VALVE, MODEL B-6000  
(DISTRICT SUPPLIED AND INSTALLED)

1" A36 STEEL PIPE  
(DISTRICT SUPPLIED AND INSTALLED)

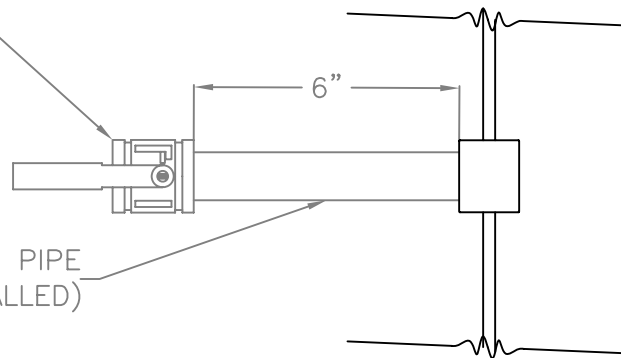

1/4" THK TANK WALL STL (E)

INSTALL 1" DIA. FIPT COUPLING

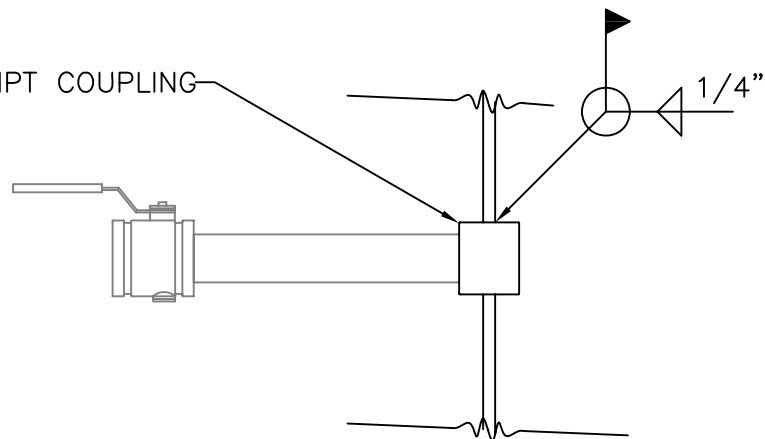

1/4" THK TANK WALL (E)

SCOPE OF WORK:

FIELD DRILL AND FIELD WELD THREE SAMPLE TAP COUPLINGS TO EXISTING TANK WALL.

G:\01\_Proj\_Current\07-142\Draw\Rev\_A\tap1.dwg 4-25-07 08:18:47 AM carolc

SAMPLE TAP DETAIL



**SOQUEL CREEK  
WATER DISTRICT**

P.O. Box 158 Soquel, California 95073  
Phone Number: (831) 475-8500  
Fax Number: (831) 475-4291

CWO NO. 07-142	PJT. NAME: PRINGLE TANK RECOAT & REPAIR	REV A
SCALE: NONE	DWN BY: TAD	SHEET: 1 OF 1