


56 - 98 SEACLIFF DR.

2 - 48 SEACLIFF DR.

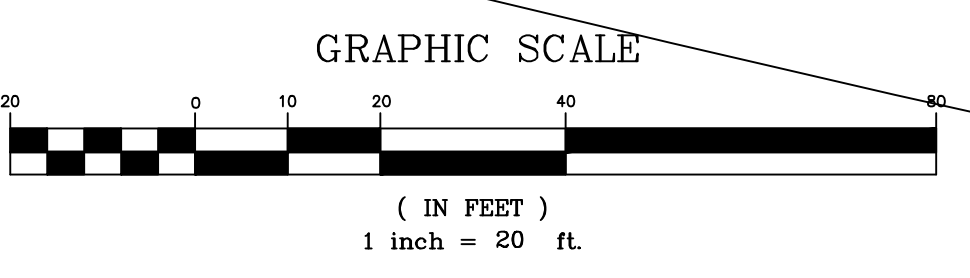

INSTALL:
 1-14"X6" FLG. TEE
 2-14" FLG. X M.J. B.V.
 1-6" FLG. X M.J. G.V.

INSTALL:
 1100 ± L.F. OF 14" PVC C905, CLASS 200 WATER MAIN
 FROM SEACLIFF DR. @ NORTH AVE. & CENTER AVE. TO
 SPRECKLES DR.

ABANDON EXISTING 6" AC MAIN PER SCWD SPECIFICATIONS
 SECTION 206.08. CONTRACTOR TO REMOVE FITTINGS AND
 VALVE IN CENTER AVE.

CONNECT TO EXISTING 4" AC WATER MAIN
 INSTALL:
 2-6" 45° M.J. ELBOW
 1-6"X4" M.J. REDUCER
 1-6" TRANSITION COUPLING
 2-6" PIPE SEGMENT, LENGTH AS REQ'D
 1-4" PIPE SEGMENT, LENGTH AS REQ'D
 33± L.F. 6" PVC C900, CLASS 200 WATER MAIN EXTENSION
 1-THRUST BLOCK PER SCWD S-7

APPLY:
 86,020 ± SQ. FT. CALTRANS TYPE 2 SLURRY SEAL FROM
 MCGREGOR DR. TO SOQUEL DR.

No.	Revision/Issue	Date
A	ISSUED FOR REVIEW	09/12/08
0	ISSUED FOR CONSTRUCTION	10/07/08

SEACLIFF AREA MAIN REPLACEMENT PHASE II
SEACLIFF DR. AND SEA TERRACE WAY

AFTOS, SANTA CRUZ COUNTY, CALIFORNIA

APN: N/A
 G:\01_Proj_Current\08-42 Draw\Rev_A-D-2_10_08-08.dwg 10-08-08 04:26:29 PM cor/c

SOQUEL CREEK WATER DISTRICT
 9610
 PO Box 1550 Capitola, California 95010
 Phone Number: (831) 475-6800
 Fax Number: (831) 475-4291

CWO. No. 08-42
 DATE: 07/22/08
 SCALE: 1"=20'
 DESIGN BY: CCC
 DWG. NO. D-08-2173-P

Certification:

 Jeffery N. Galey
 Chief Engineer
 Engineering Manager

SHEET:
D-7