

NOTE: THE PLANTER AREA HAS MANY UTILITIES IN IT AND WILL REQUIRE CONTRACTOR TO HAND DIG.

CONTRACTOR SHALL CALL U.S.A. TO MARK LOCATIONS OF ALL UNDERGROUND UTILITIES PRIOR TO START OF CONSTRUCTION

MOVE EXISTING STEAMER FIRE HYDRANT BEHIND SIDEWALK PER SCWD S-9 & S-10.

1-6" PVC PIPE SEGMENT, LENGTH AS REQ'D. C900 CLASS 200.

1-6" TRANSITION COUPLING

1-HYDRANT BURY W/EXTENSION AS REQ'D., PVC WRAP, BREAK-OFF SPOOL W/BREAK-AWAY BOLTS.


1-THRUST BLOCK PER SCWD S-7.

BACK FILL TRENCH W/SAND COMPACTED TO 95% AS PER SCWD S-15.

INSTALL CONCRETE HYDRANT PAD

REPLACE CONCRETE PANEL FROM JOINT TO TELEPHONE VAULT AS PER SCWD SECTION 308.

SAW CUT SIDEWALK AT TELEPHONE VAULT. REPLACE SIDEWALK SECTION TO TELEPHONE VAULT.

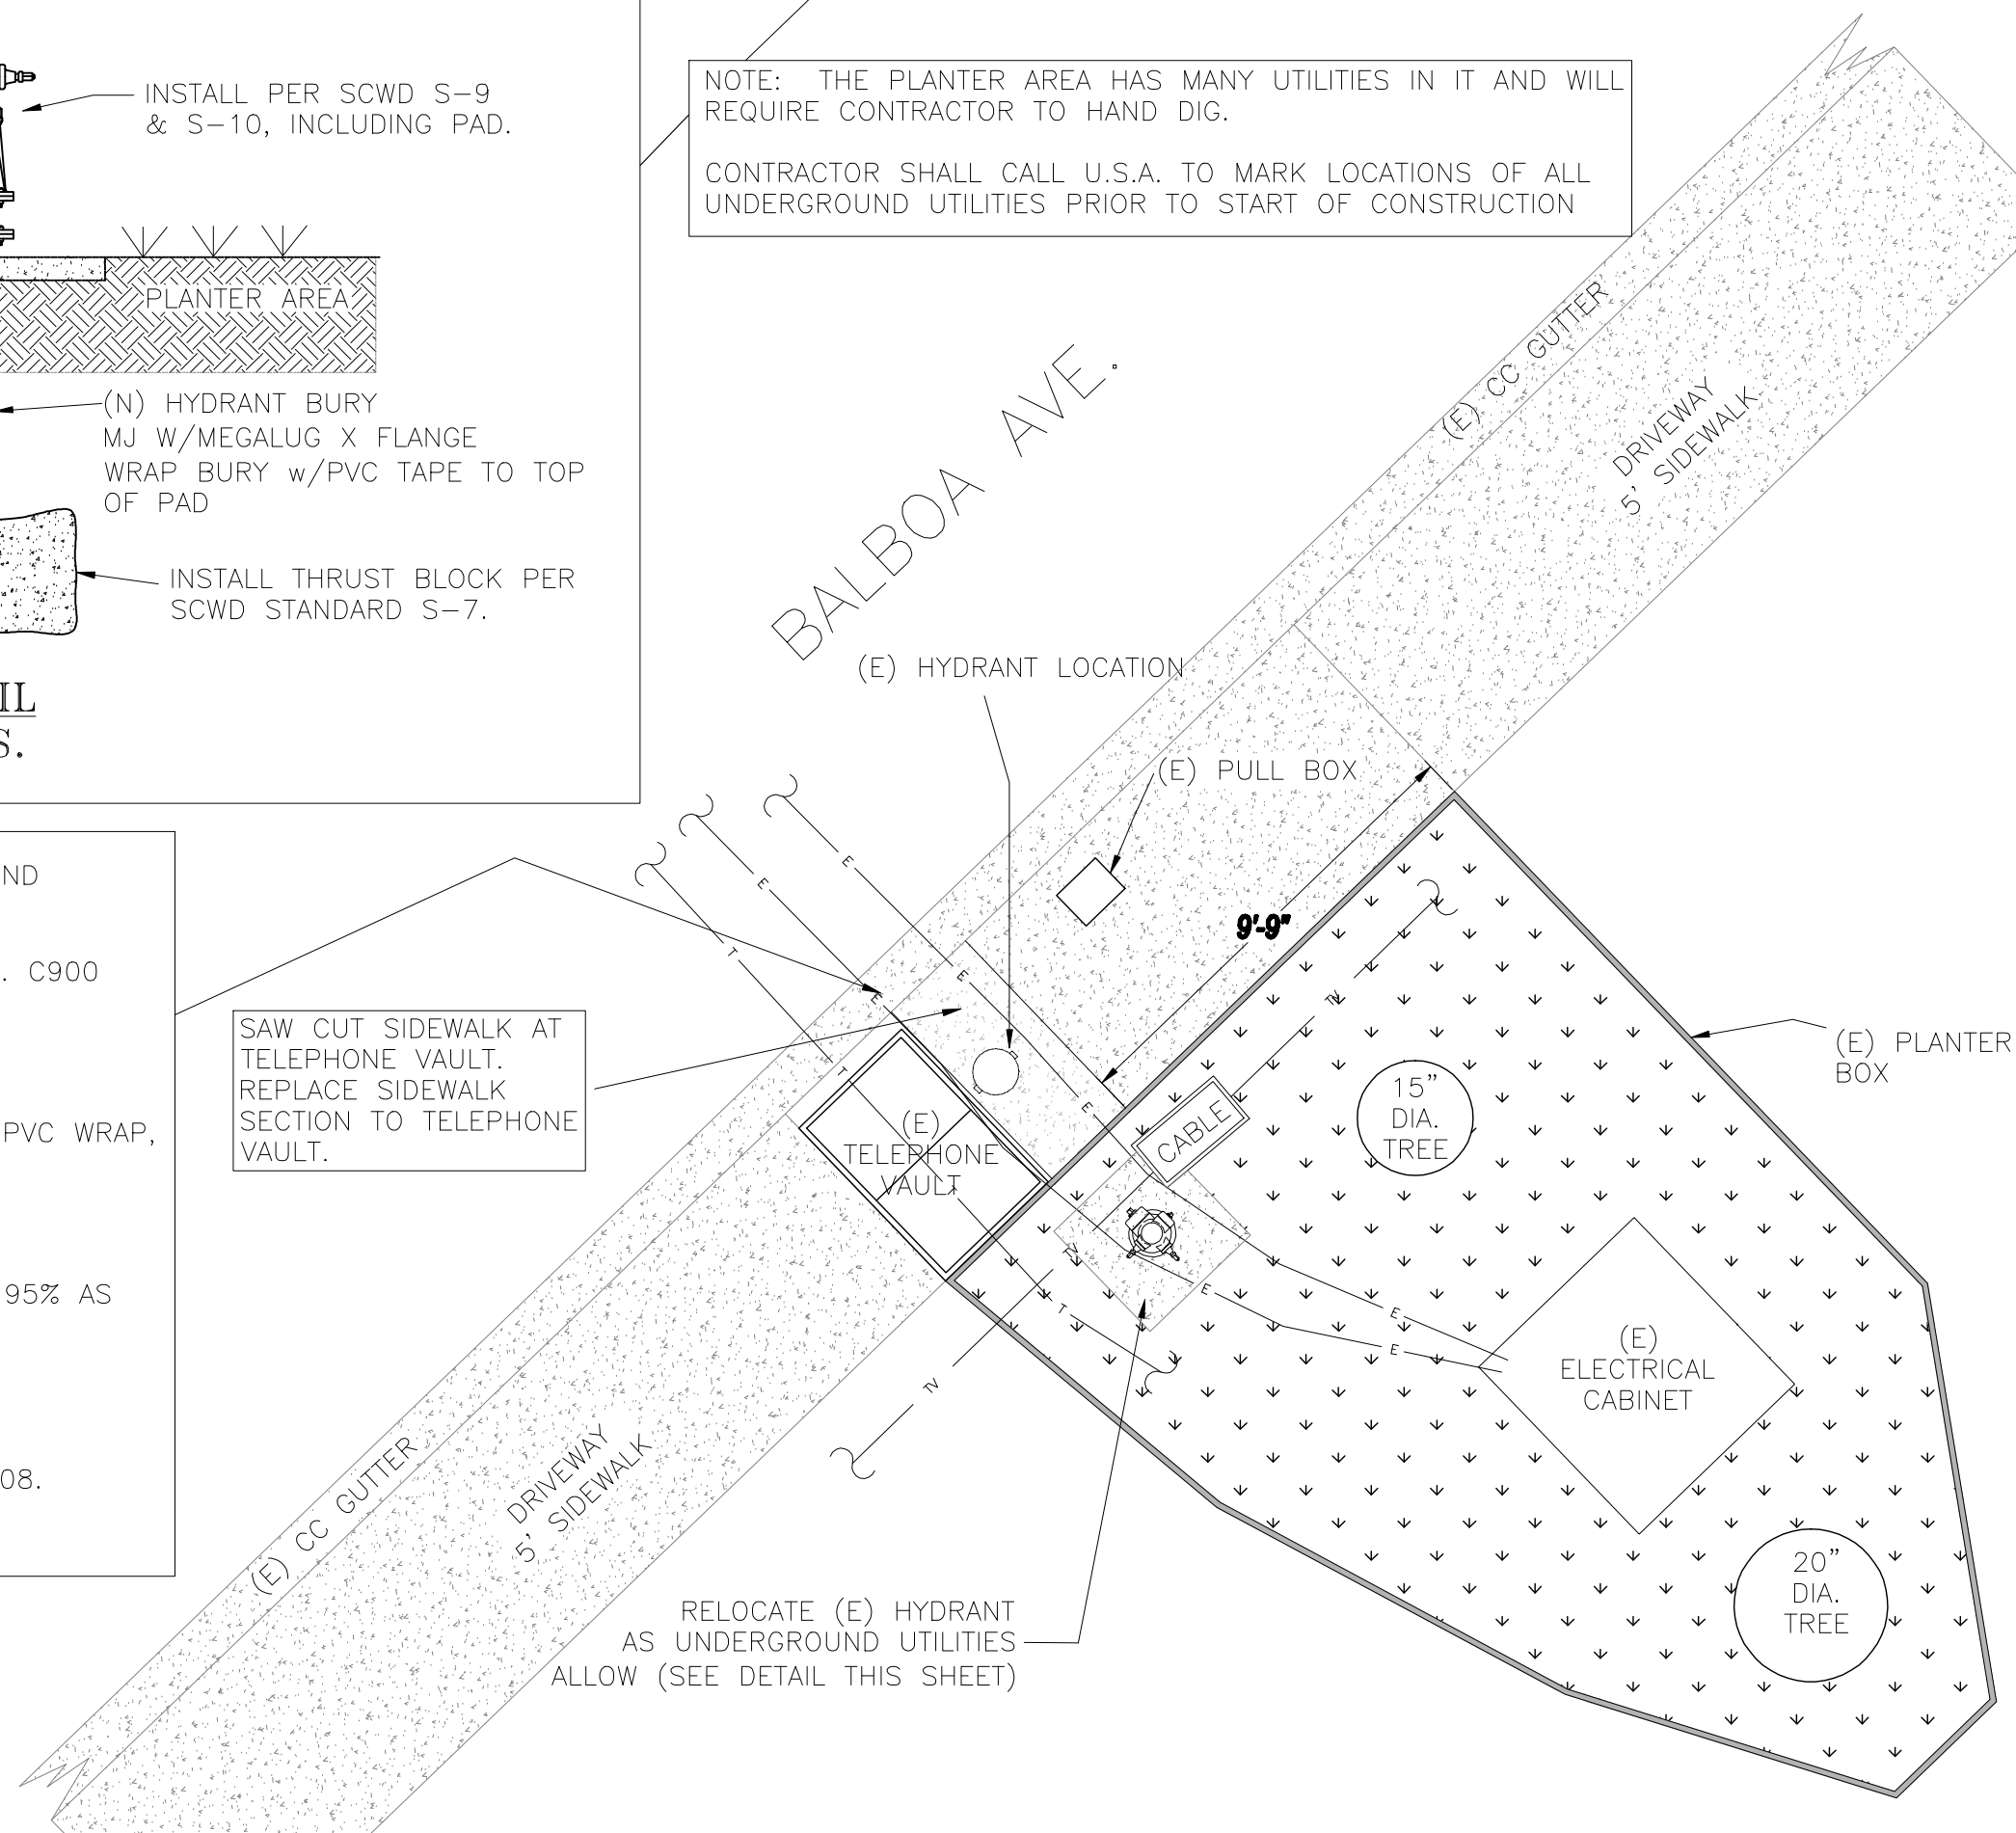

RELOCATE (E) HYDRANT AS UNDERGROUND UTILITIES ALLOW (SEE DETAIL THIS SHEET)

No.	Revision/Issue	Date
A	ISSUED FOR REVIEW	7/15/08
0	ISSUED FOR CONSTRUCTION	10/21/08

**FIRE HYDRANT RELOCATION AT 870 BALBOA DR.**

CAPITOLA, SANTA CRUZ COUNTY, CALIFORNIA

APN: N/A  
G:\01\_Proj\_Current\08-50\Draw\Rev\_0\B-2\_Wharf Rd. AND Balboa Dr.dwg 10-21-08 08:52:26 AM carlc

CWO. NO. 08-050  
DATE: 7/14/08  
SCALE: 1/4"=1'  
DESIGN BY: SSS

DWG. NO.  
B-08-2172-H

**SOQUEL CREEK WATER DISTRICT**  
PO Box 1550 Capitola, California 95010  
Phone Number: (831) 475-6500  
Fax Number: (831) 475-4291