


RELOCATE EXISTING STEAMER FIRE HYDRANT PER SCWD S-9 & S-10.

INSTALL:
 2-6" 90° M.J. ELBOW W/MEGALUGS
 THRUST BLOCK PER SCWD S-7.
 BLOCKING FOR TEMPORARY THRUST.
 2-6" PIPE SEGMENTS, LENGTH AS REQ'D.
 1-6" HYDRANT BURY W/MEGALUGS & BREAK-OFF SPOOL
 1-3'X3' PCC PAD
 1-G.I.P. BOLLARD
 REUSE EXISTING HYDRANT BODY
 ~ 6-FT OF 2"X12" RETAINING WALL
 BACKFILL W/SAND BEDDING AND 1-SACK SLURRY.
 REPAIR ASPHALT PER CITY OF CAPITOLA STANDARD S-20

WHARF ROAD

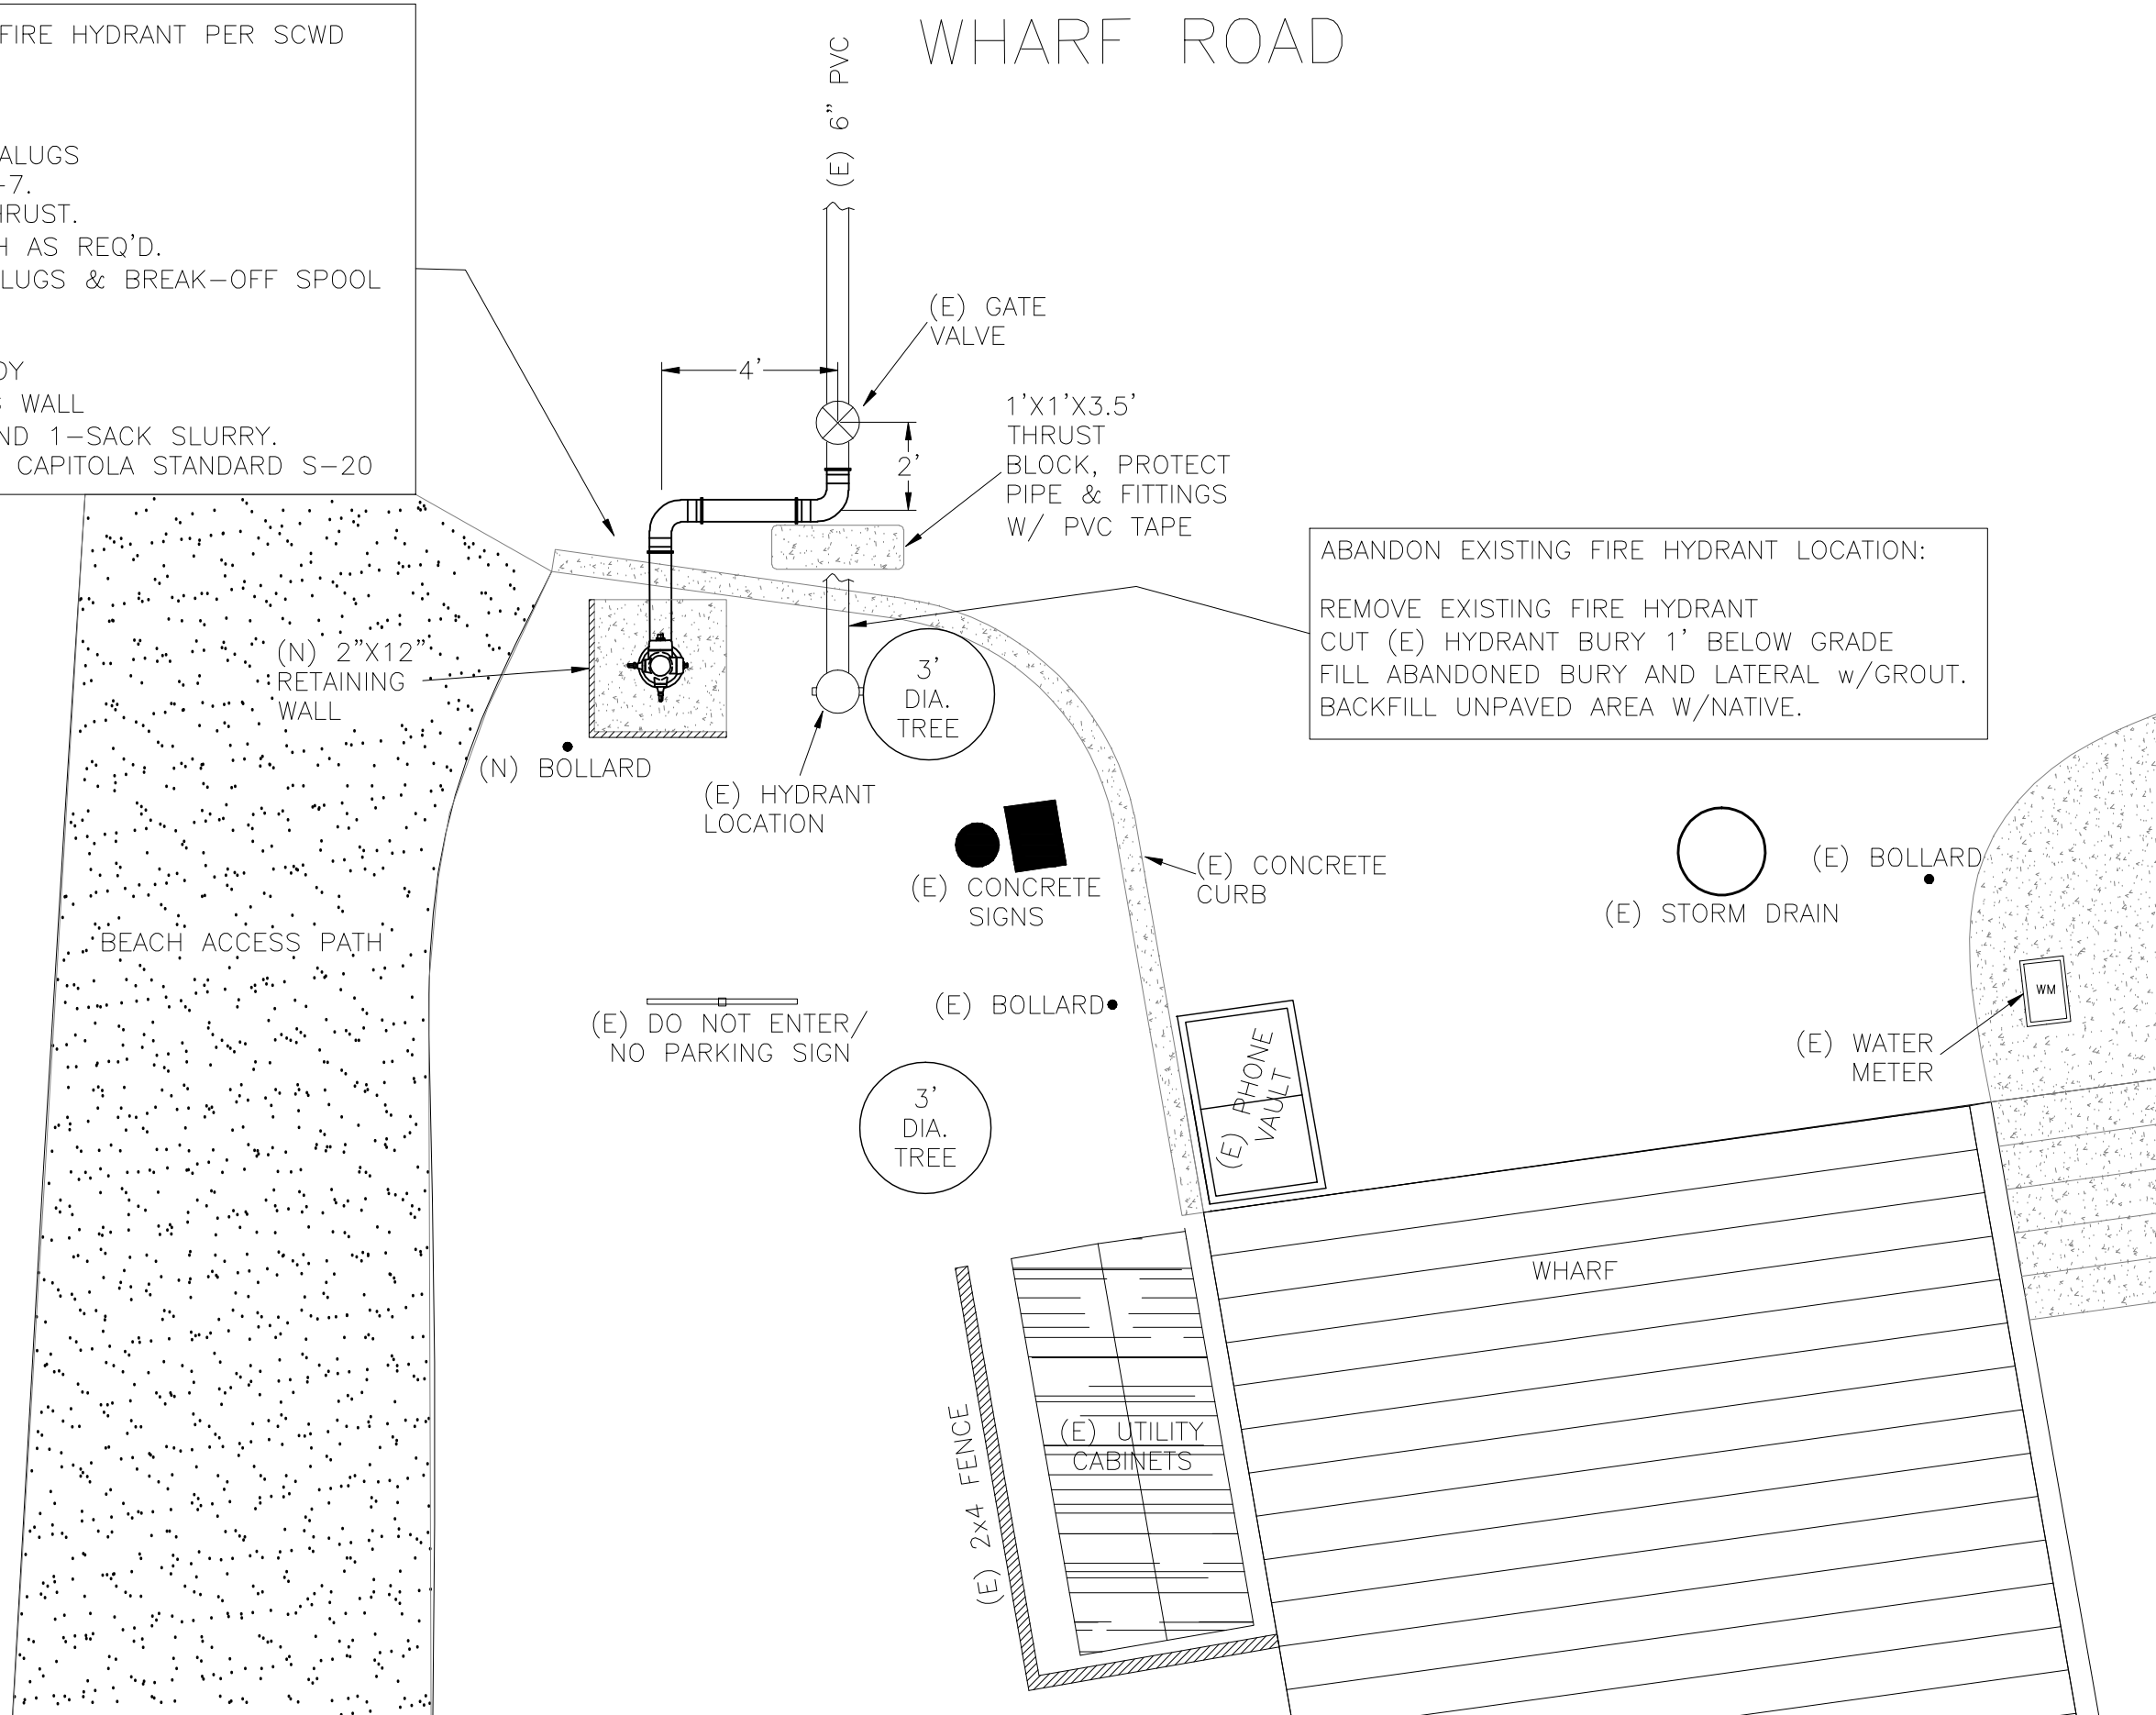

ABANDON EXISTING FIRE HYDRANT LOCATION:
 REMOVE EXISTING FIRE HYDRANT
 CUT (E) HYDRANT BURY 1' BELOW GRADE
 FILL ABANDONED BURY AND LATERAL w/GROUT.
 BACKFILL UNPAVED AREA W/NATIVE.

FIRE HYDRANT RELOCATION AT 1435 WHARF RD.

No.	Revision/Issue	Date
A	ISSUED FOR REVIEW	07/30/08
0	ISSUED FOR CONSTRUCTION	10/21/08

CW. NO. 08-050
 DATE: 7/30/08
 SCALE: 1/4" = 1'
 DESIGN BY: SSZ

DWG. NO.
 B-08-2172-H

SOQUEL CREEK WATER DISTRICT
 PO Box 1550 Capitola, California 95010
 Phone Number: (831) 475-6500
 Fax Number: (831) 475-4291

SHEET
B-3

CAPITOLA, SANTA CRUZ COUNTY, CALIFORNIA
 G:\01_Proj_Current\08-50\Draw\Rev_0\B-2_Wharf Rd. AND Baboo Dr..dwg 10-21-08 08:53:26 AM ccoric
 APN: N/A